





PRINCIPAL DIMENSIONS - mm

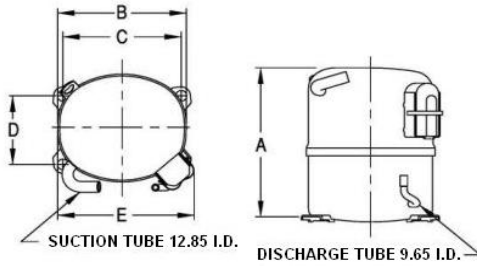

A: 264	B: 223	C: 203	D: 122	E: 239
--------	--------	--------	--------	--------


SCHEMATIC WIRING DIAGRAM C.S.R.

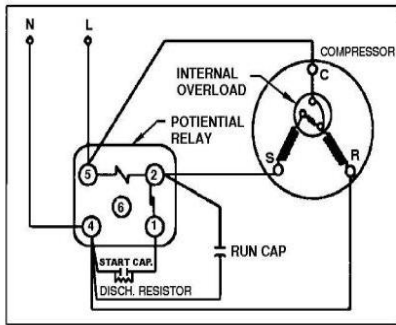

High Torque Start

SCHEMATIC WIRING DIAGRAM -

MOUNTING KIT

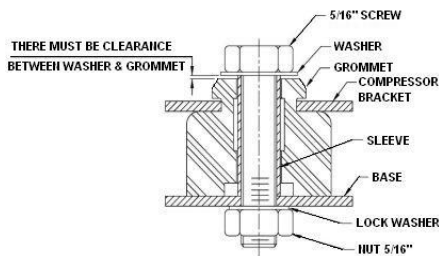

Electrical : 220-240 V/50 Hz. 1 Phase

Nominal Performance

Capacity	2,345 / 3,986 Watts
	8,001 / 13,600 BTU/Hr
	2,016 / 3,427 Kcal/Hr
Power Input	1,400 / 1,833 Watts
Locked Rotor Amps	33.00 / 33.00 Amps
Max Continuous Current	- / - Amps
Rated Load Amps	7.00 / 9.00 Amps
COP	1.68 / 2.17 Watts / Watts
EER	5.72 / 7.42 BTU/W-Hr

Testing Conditions

Condensing Temperature	54.40 °C	129.9 °F
Evaporating Temperature	-6.70 / 7.20 °C	19.9 / 45.0 °F
Liquid Temperature	46.10 °C	115.0 °F
Return Gas Temperature	35.00 °C	95.0 °F
Ambient Temperature	35.00 °C	95.0 °F

Application

Evaporating Temp. Range	MBP/HBP	@ -23.30 °C to 12.70 °C (-9.9° F to 54.9° F)
	Heat Pump	- °C to - °C (-° F to -° F)
Refrigerant	R404A	
Refrigerant Flow Control	Capillary tube/Expansion valve	
Compressor Cooling	Fan	

Compressor and Motor data

Compressor Type	Reciprocating
Displacement	26.70 cc.
Oil Type	Polyolester Oil
Oil Charge	850 cc.
Motor Type	C.S.R. ; 2 Pole 2,850 / 2,850 r/m
Voltage Range	198-264/- Volts 50/- Hz.
Winding Resistance at 25 °C	
Start	4.30 Ohms
Run	1.98 Ohms
Weight with Oil	22.56 Kg.
Weight with Oil and Accessories	23.13 Kg.

Electrical Components

Motor Protector

Type	Internal Overload
Model Number	4042KGE656-6
Open / Close	125-135 / 78-60 °C
1st Cycle trip at 25 °C	24.00 Amps(main) 37.00 Amps(start)

Motor Starter

Type	Potential Relay
Model Number	4043KGE681-9 (RVA4AM6D)
Pick Up (max.)	242.00-272.00 Volts
Drop Out (min.)	60.00-121.00 Volts
Terminal Cover	KGM 901-1
Start Capacitor	108-130 µF 330 VAC.
Disch Resistor for Start Cap	15000
Run Capacitor	20 µF 440 VAC.

Mounting Kit

Rubber Grommet	4007KGM905-2
Sleeve Grommet	4023KGM903-2
Washer	-

Since we are constantly improving our product , the specification are subject to change without notice.

REV. DATE
10-02-14

C / N No.
0063/14

Certificate Marks

